DH7001 TCP[illegible]

| | | | |
|---|---|---|---|
| [illegible] | [illegible] | [illegible]2[illegible] | [illegible]4[illegible] |
| [illegible] | DH-7001 | DH-7002 | DH-7004 |
| [illegible] | TCP / IP 10M / 100M [illegible] | TCP / IP 10M / 100M [illegible] | TCP / IP 10M / 100M [illegible] |
| [illegible] | [illegible]1[illegible] | [illegible]2[illegible] | [illegible]4[illegible] |
| PCB[illegible] | 160 * 106[illegible] | 160 * 106[illegible] | 160 * 106[illegible] |
| [illegible] | 273 * 228 * 65mm | | |
| [illegible] | 12VDC 4-7A | | |
| [illegible] | [illegible]100mA | | |
| [illegible] | [illegible]26[illegible]Motorola[illegible]HID[illegible]EM[illegible]Mifare[illegible] | | |
| [illegible] | 2[illegible] | 4[illegible] | 4[illegible] |
| [illegible] | 1[illegible] | 2[illegible] | 4[illegible] |

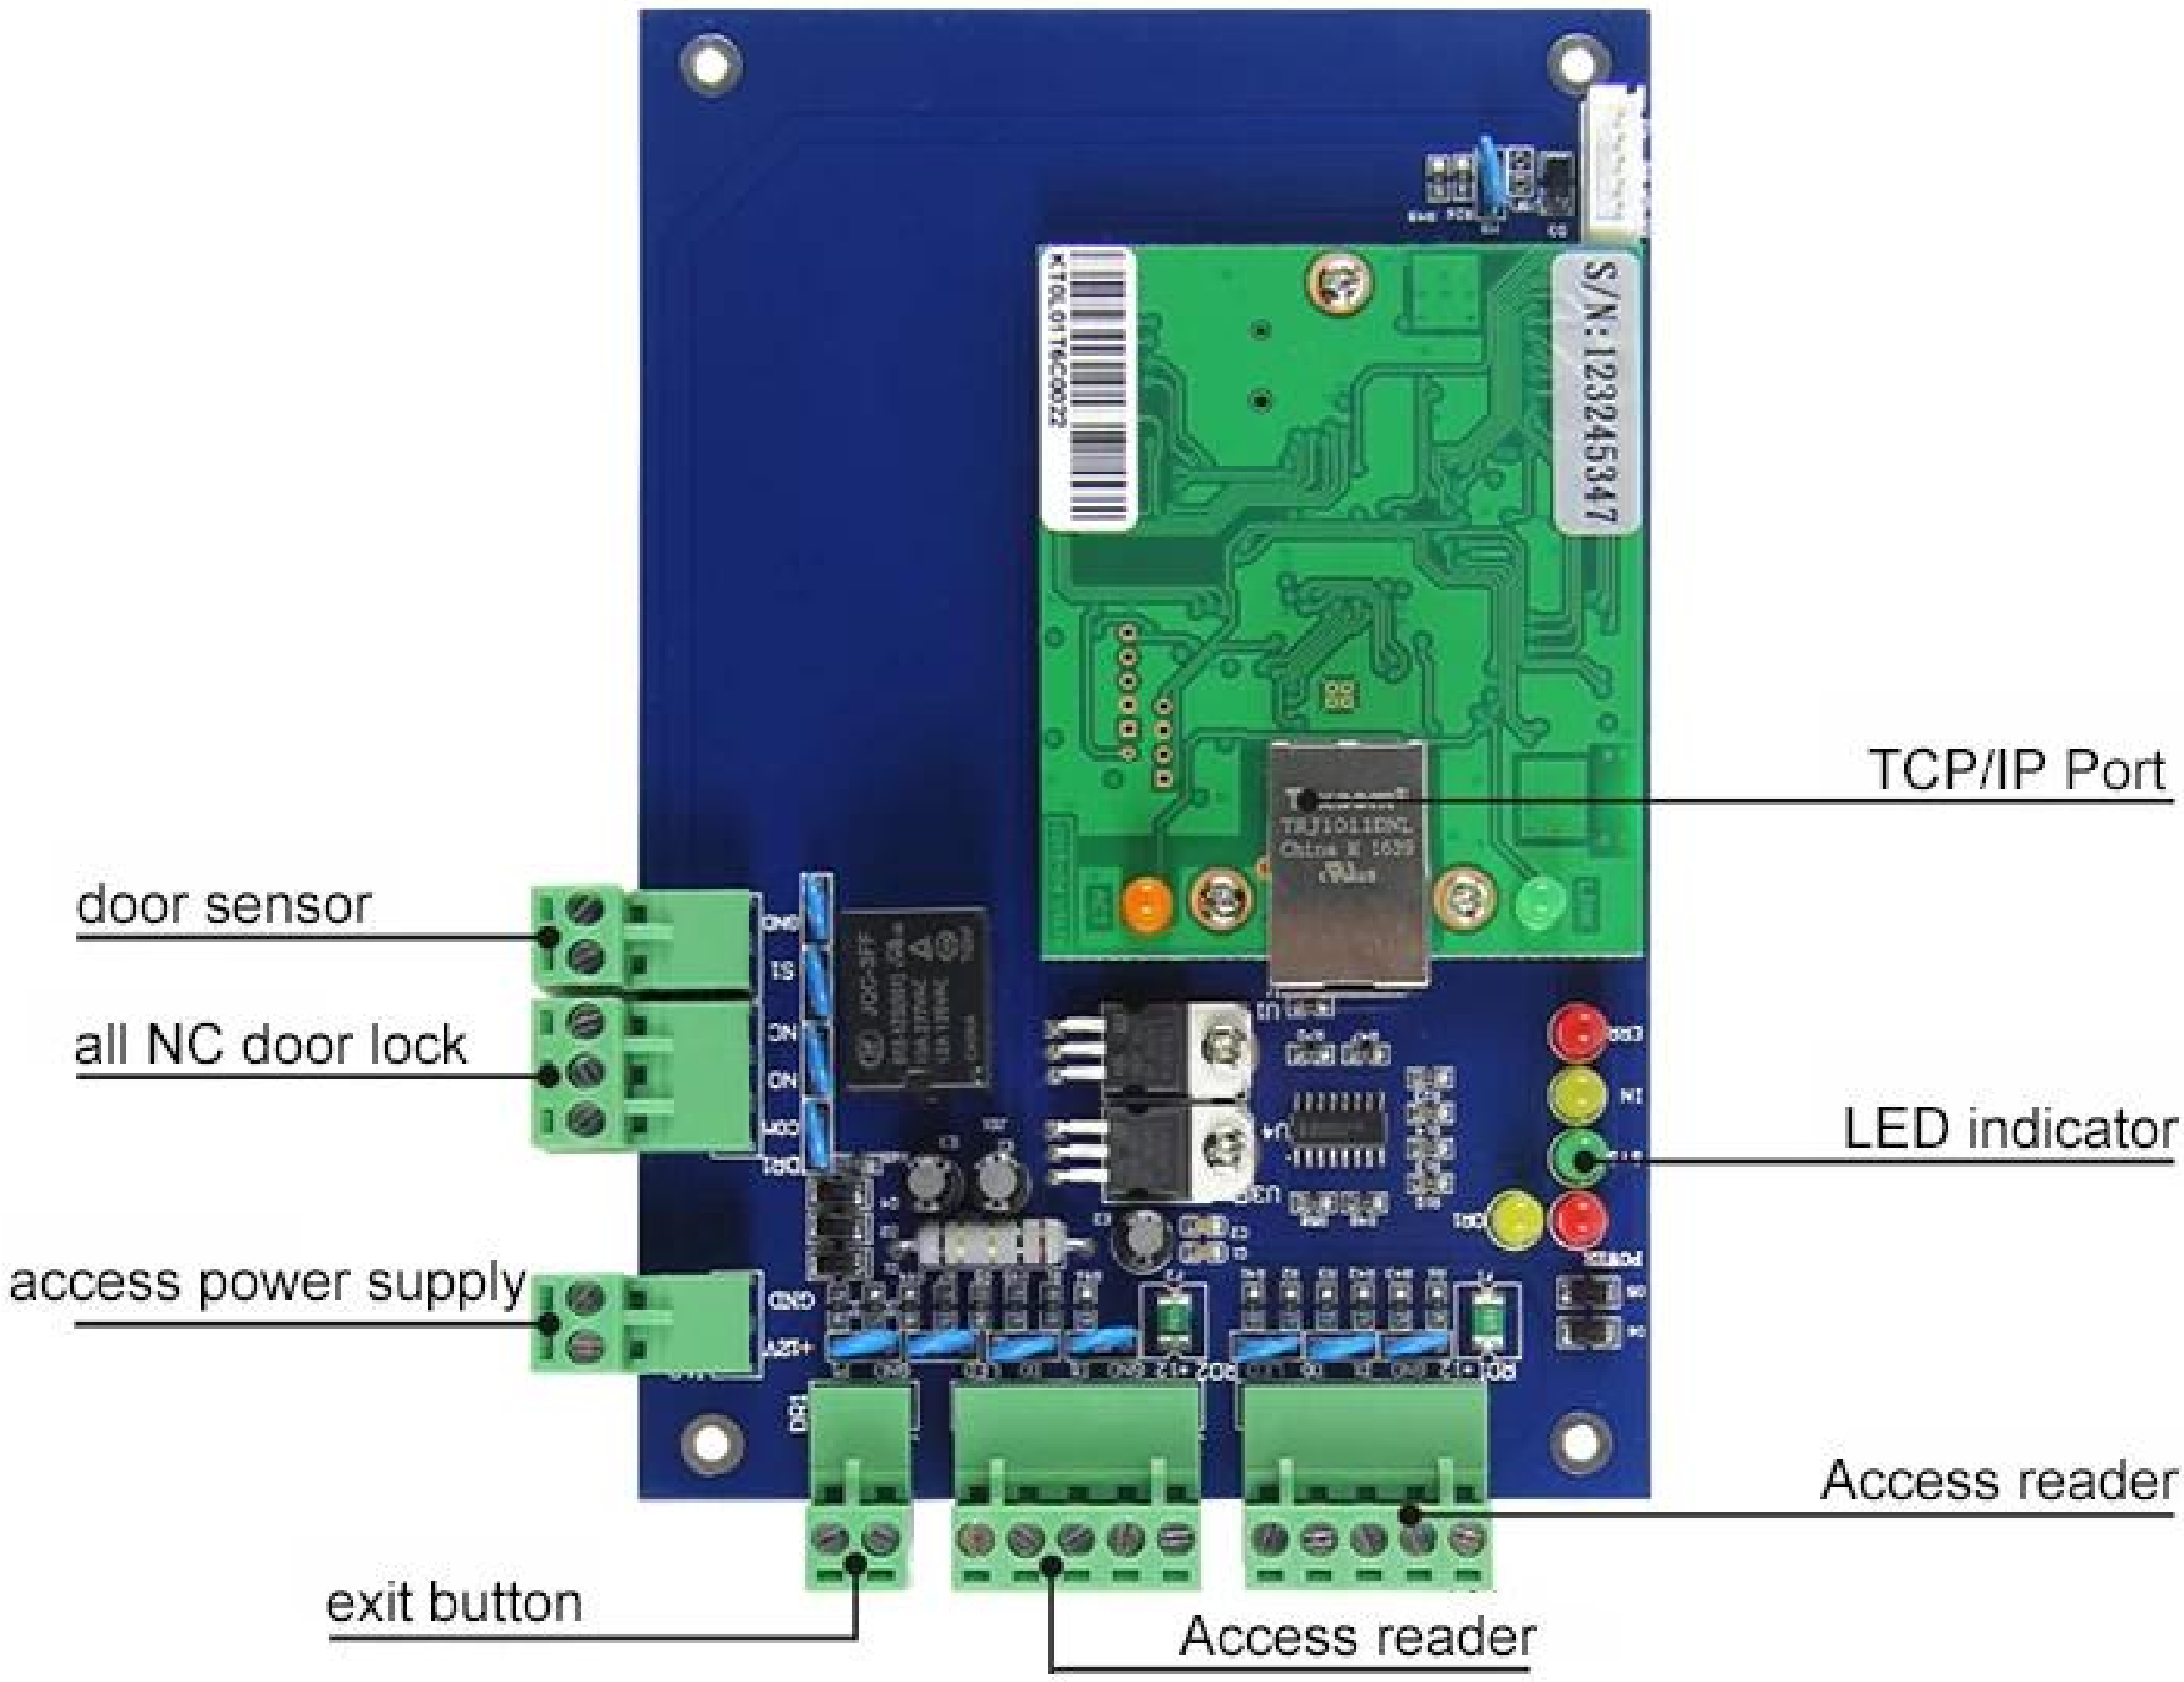
TCP/IP Port
door sensor
all NC door lock
LED indicator
access power supply
Access reader
exit button
Access reader
S/N:123245347

□□□
□□□□□□□TCP / IP□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□PC□□□□□□□□
□□□□□□□□□□□□□□□□□□□□□□□□□□□□□ □□□□□□□□□□□□□□□□□□□□□
□□□□□□□□□□□□□□□□□□□□□□□□□RF□□□□□□
□□□□□□□□□□□□□□□□□□□□□□□□□□□
□□□□□□□□□□□□□□□□□□□□□□□□□
□□□□□□□□□□□□□□□□□□□□□□□□□;□□□□□□□□□□□□□□□□□;□□□□□□□□□□□□□□□□□□□

01 TCP/IP port

02 LED indicator

03 Fix wires by screws

04 Original components

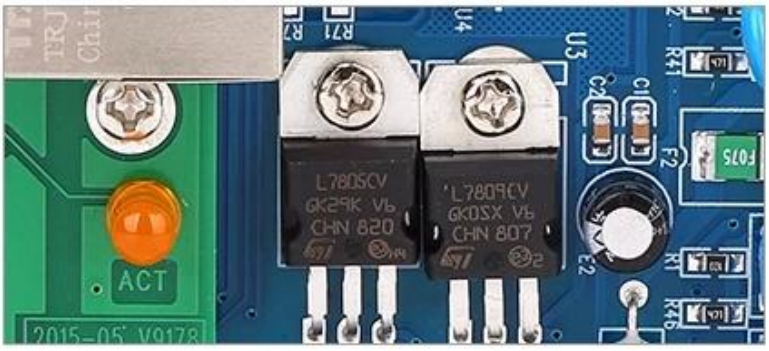

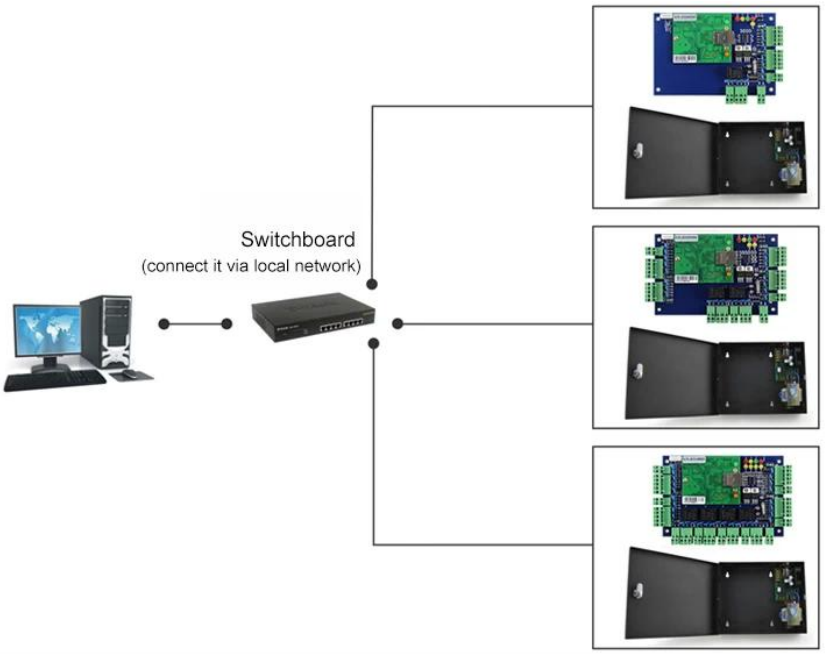


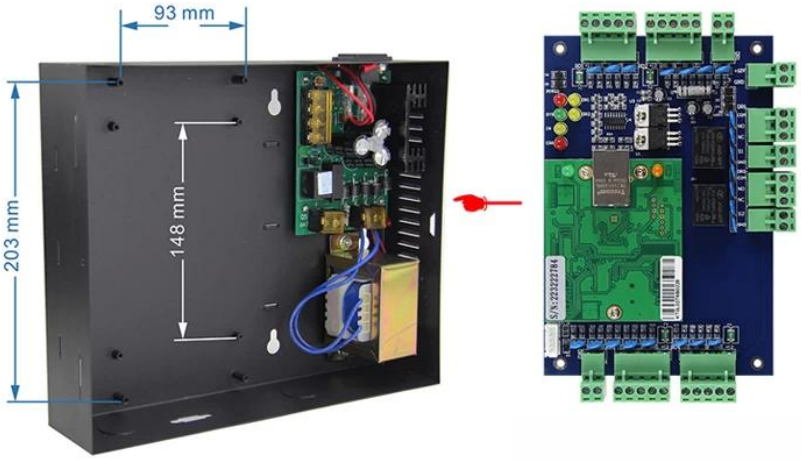


Kindly remind:

All network control board must configure with access power supply.
1 board for 1 power supply

RFID Reader | Exit Button | Electric Lock | Power Supply | Alarm and Fire Control Expansion Panel | Alarm

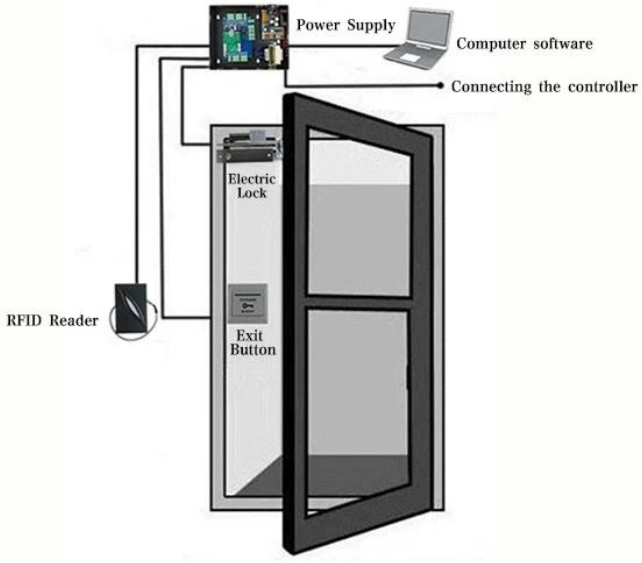

[illegible];[illegible]

[illegible];[illegible];[illegible]excel[illegible];[illegible]+
[illegible]